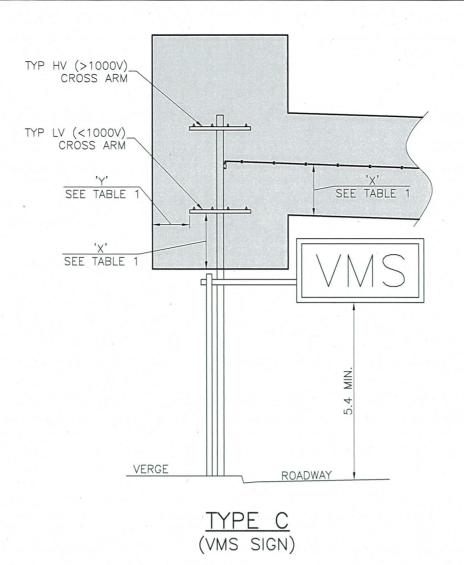


<u>TYPE C</u> (2.5m, 5.0m, 6.5m, 8.5m & 11.0m OUTREACH)



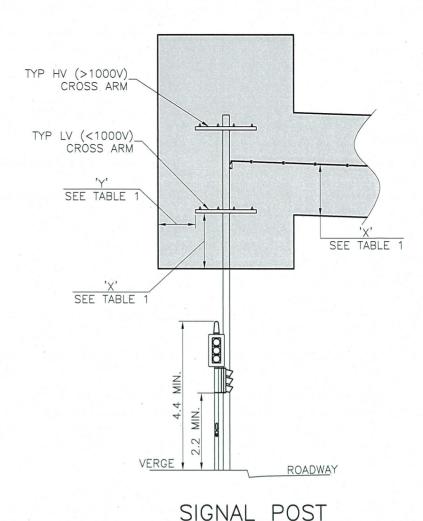


TABLE 1

PHASE TO PHASE VOLTAGE OF POWER LINE	VERTICAL DIMENSION 'X'	HORIZONTAL DIMENSION 'Y'
LOW VOLTAGE INSULATED NOT EXCEEDING 1000 VOLTS	0.6	0.3
LOW VOLTAGE SERVICE CABLES	1.2	1.2
LOW VOLTAGE UNINSULATED NOT EXCEEDING 1000 VOLTS	1.5	1.5
NOT EXCEEDING 33,000 VOLTS	1.5	1.5
EXCEEDING 33,000 VOLTS	REFER TO ELECTRICITY AUTHORITY CONCERNED	REFER TO ELECTRICITY AUTHORITY CONCERNED

NOTES

- 1. THE RELEVANT ELECTRICITY DISTRIBUTION ENTITY SHOULD BE CONSULTED WHENEVER THERE IS ANY DOUBT AS TO WHETHER SAFETY CLEARANCES COULD BE ADEQUATELY MAINTAINED.
- 2. HIGH VOLTAGE (HV, >1000 VOLTS) LINES ARE GENERALLY POSITIONED ABOVE LOW VOLTAGE (LV, <1000 VOLTS) LINES IF THEY ARE SUPPORTED ON THE SAME POLES. IF THEY ARE SEPARATED, CONSULT THE RELEVANT ELECTRICAL DISTRIBUTION ENTITY IF THERE IS ANY DOUBT ON WHETHER THE LINE IS OF HIGH OR LOW VOLTAGE.
- 3. THIS PLAN SHOWS THE MINIMUM CLEARANCES AS REQUIRED BY THE QUEENSLAND ELECTRICAL SAFETY LEGISLATION. CONSIDERATION SHOULD BE GIVEN TO THE REQUIREMENTS OF AS 1418.10 S.A.A. CRANE CODE, THE WORKPLACE HEALTH SAFETY ACT (1995), WORKPLACE HEALTH SAFETY CODE OF PRACTICES, WORKPLACE HEALTH SAFETY REGULATION (2008).
- 4. ALL CREW WORKING NEAR OR WITHIN THE NOMINATED EXCLUSION ZONES TO BE SUITABLY TRAINED AND FULLY AWARE OF THE REQUIREMENTS OF THE RELEVANT LEGISLATION AND CODES OF PRACTICE.
- 5. ALL DIMENSIONS IN METRES (U.N.O.).

LEGEND



NO CONSTRUCTION ZONE

100									
					DRAWING AUTHORISED FOR PUBLICATION B. BALL SIGNATURE ON ORIGINAL	DESIGN	Std Dwgs WG	DATE	April '01
						DRAWN	CPO - P&D	DATE	April'01
				1	MANAGER ASSET SUPPORT - R.P.E.Q: 3 8 5 2	CHECKED	D WII CON	DATE	Ma '01
В	CABLE CLEARANCES AMENDED	BUSPIL	AUG 5/9/16	MK 1/9/16		LHECKED	R. WILSON	DATE	May '01
Α	Drawing Converted from UMS Series April 2014	APR '14	APR 14	APR '14	K. MEMORY SIGNATURE ON ORIGINAL DATED 27/6/01	DRAWING FILENAME	BSD-4001.dwg		
ISSUE	AMENDMENT	DRAWN DATE	CHK'D DATE	APPR'D DATE	SENIOR PROGRAM OFFICER NETWORK OPERATIONS - R.P.E.Q: 4 7 6 1	ASSOCIATED PLANS	SUPERSEDES UMS-600-01	0	



BRISBANE CITY COUNCIL STANDARD DRAWING

ELECTRICAL CABLE DESIGN CLEARANCES

•				WAA T	110
	SCALE	NOT	TO	SCALE	
	DWG No.	- 1			
		RSI)—	4001	14-1
					100
	ORIGINAL S	SIZE		REVISION	
		A 3		R	
		112	- 1		